


TYPICAL CROSS-SECTION EMBANKMENT

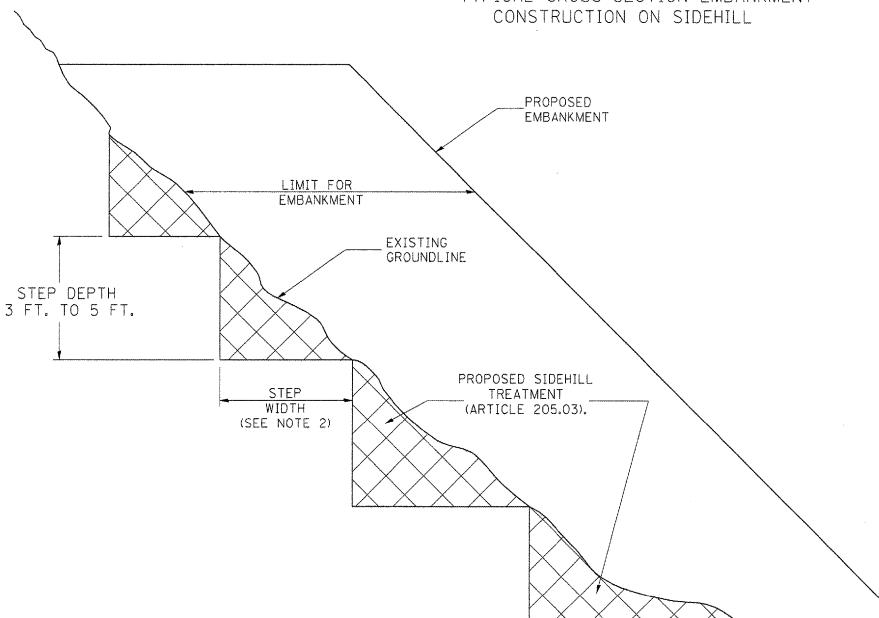

GENERAL NOTES:

- 1. Slope Steps will be required for all 300(12) minimum thickness "silver fills" and on a fills with a height of 3.0m(10').
- 2. The Step width shall be twice the Step depth but not less than 6 feet.
- 3. Refer to Article 205.03 for Embankment to be constructed on Hillside or Slopes, or if existing Embankments are to be widened.

All dimensions are in millimeters (inches) unless otherwise noted.

REPLACEMENT MATERIAL:

STANDARD EMBANKMENT (IN ACCORDANCE WITH 205 OF THE STANDARD SPECIFACATION). REVISIONS
RENUM. L-5.03, NEW REVISION
BOX, REVISED TITLE BOX,
REVISED GENERAL NOTES.

SLOPE STEPS DETAIL

ILLINOIS DEPARTMENT OF TRANSPORTATION

DISTRICT CADD STANDARD

CADD STD. NO. 205001-04 SCALE: NOT DRAWN TO SCALE DATE \$8DATE\$8

DRAWN BY CADD CHECKED BY

205001-D4

BE REVIEWED INDEPENDENTLY FOR TREATMENT REQUIRED. WITH NOTE ON APPLICABLE TYPICAL SECTIONS.

NOTE: EACH PROJECT SHOULD BE . REFER TO THIS DETAIL V

DESIGNER 1.